

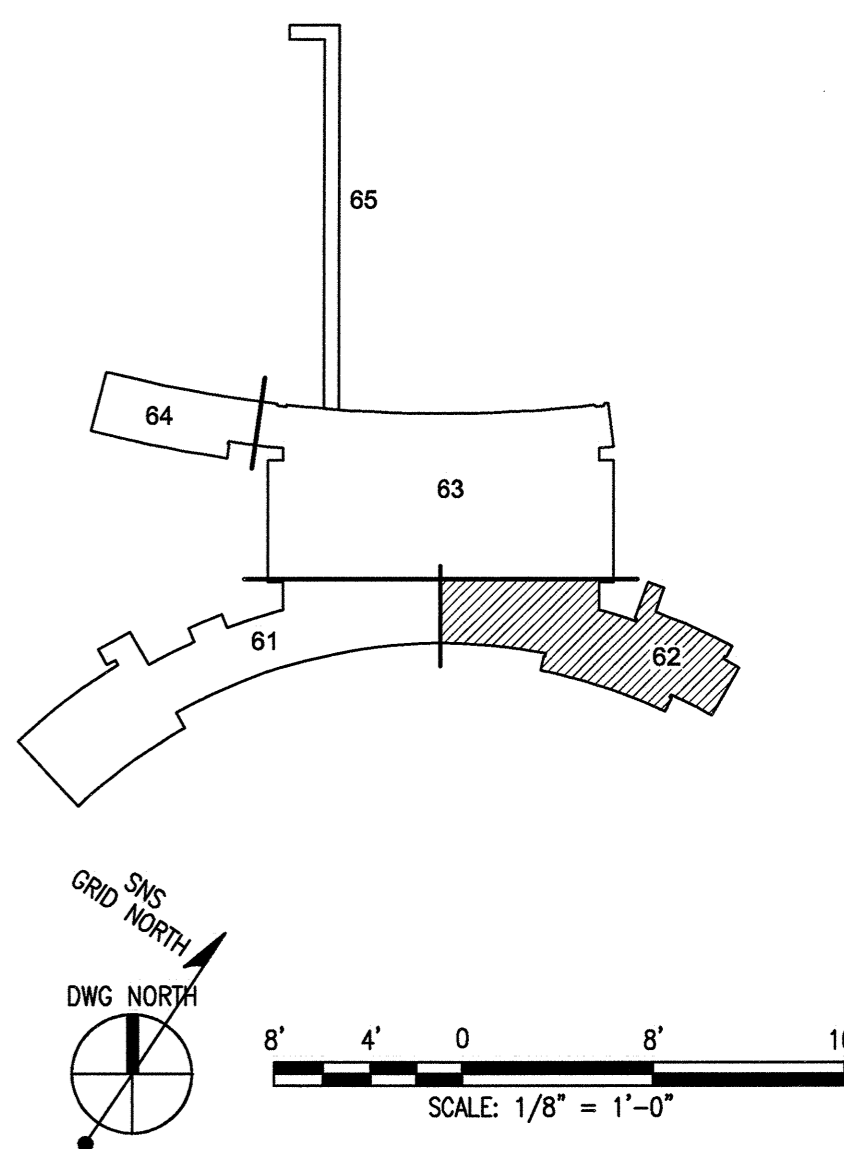


- |      |  |
|------|--|
| N002 | FINISHED SLAB ELEVATION OF SERVICE YARD IS 1037.75   |
| N003 | PM/POW LINES SHALL BE RUN AT A ELEVATION OF 1048.0. PIPING SHALL PENETRATE THE FOUNDATION WALL AND BE FLANGED APPROXIMATELY 6" INCHES FROM THE INTERIOR FACE OF THE WALL. EXTERIOR PIPING SHALL EXTEND 5 FEET AND BE CAPPED. |
| N006 | EXTERIOR PIPING SHALL EXTEND 5' FEET FROM BUILDING AND BE CAPPED.  |
| N007 | PIPES TO BE STUBBED 12" AFF WITH BLIND FLANGE FOR FUTURE CONNECTION.   |
| N008 | SUMP BASIN: 30" DIA X 5'-0" DEEP. THE POLYESTER BASIN SHALL BE ENCASED IN CONCRETE PIT (50" I.D W/ 6" WIDE WALLS). STEEL BASE PLATES TO BASIN TO PIT.  |
| N009 | GREASE INTERCEPTOR: 23"W X 32-1/4"LONG X 53-1/2" DEEP. INLET INVERT AT -2'-10" (105.369) BENEATH FINISHED FLOOR. INTERCEPTOR TO BE ENCASED IN 6" THICK CONCRETE ENCASEMENT PIT. ALLOW 2"+/- GROUT TO SET FLUSH WITH FLOOR.   |
| N010 | BACKFLOW PREVENTER SHALL BE OF THE REDUCED PRESSURE TYPE   |
| N011 | PROVIDE LOCKABLE BALL VALVE PER SPECIFICATION 1510.0.  |

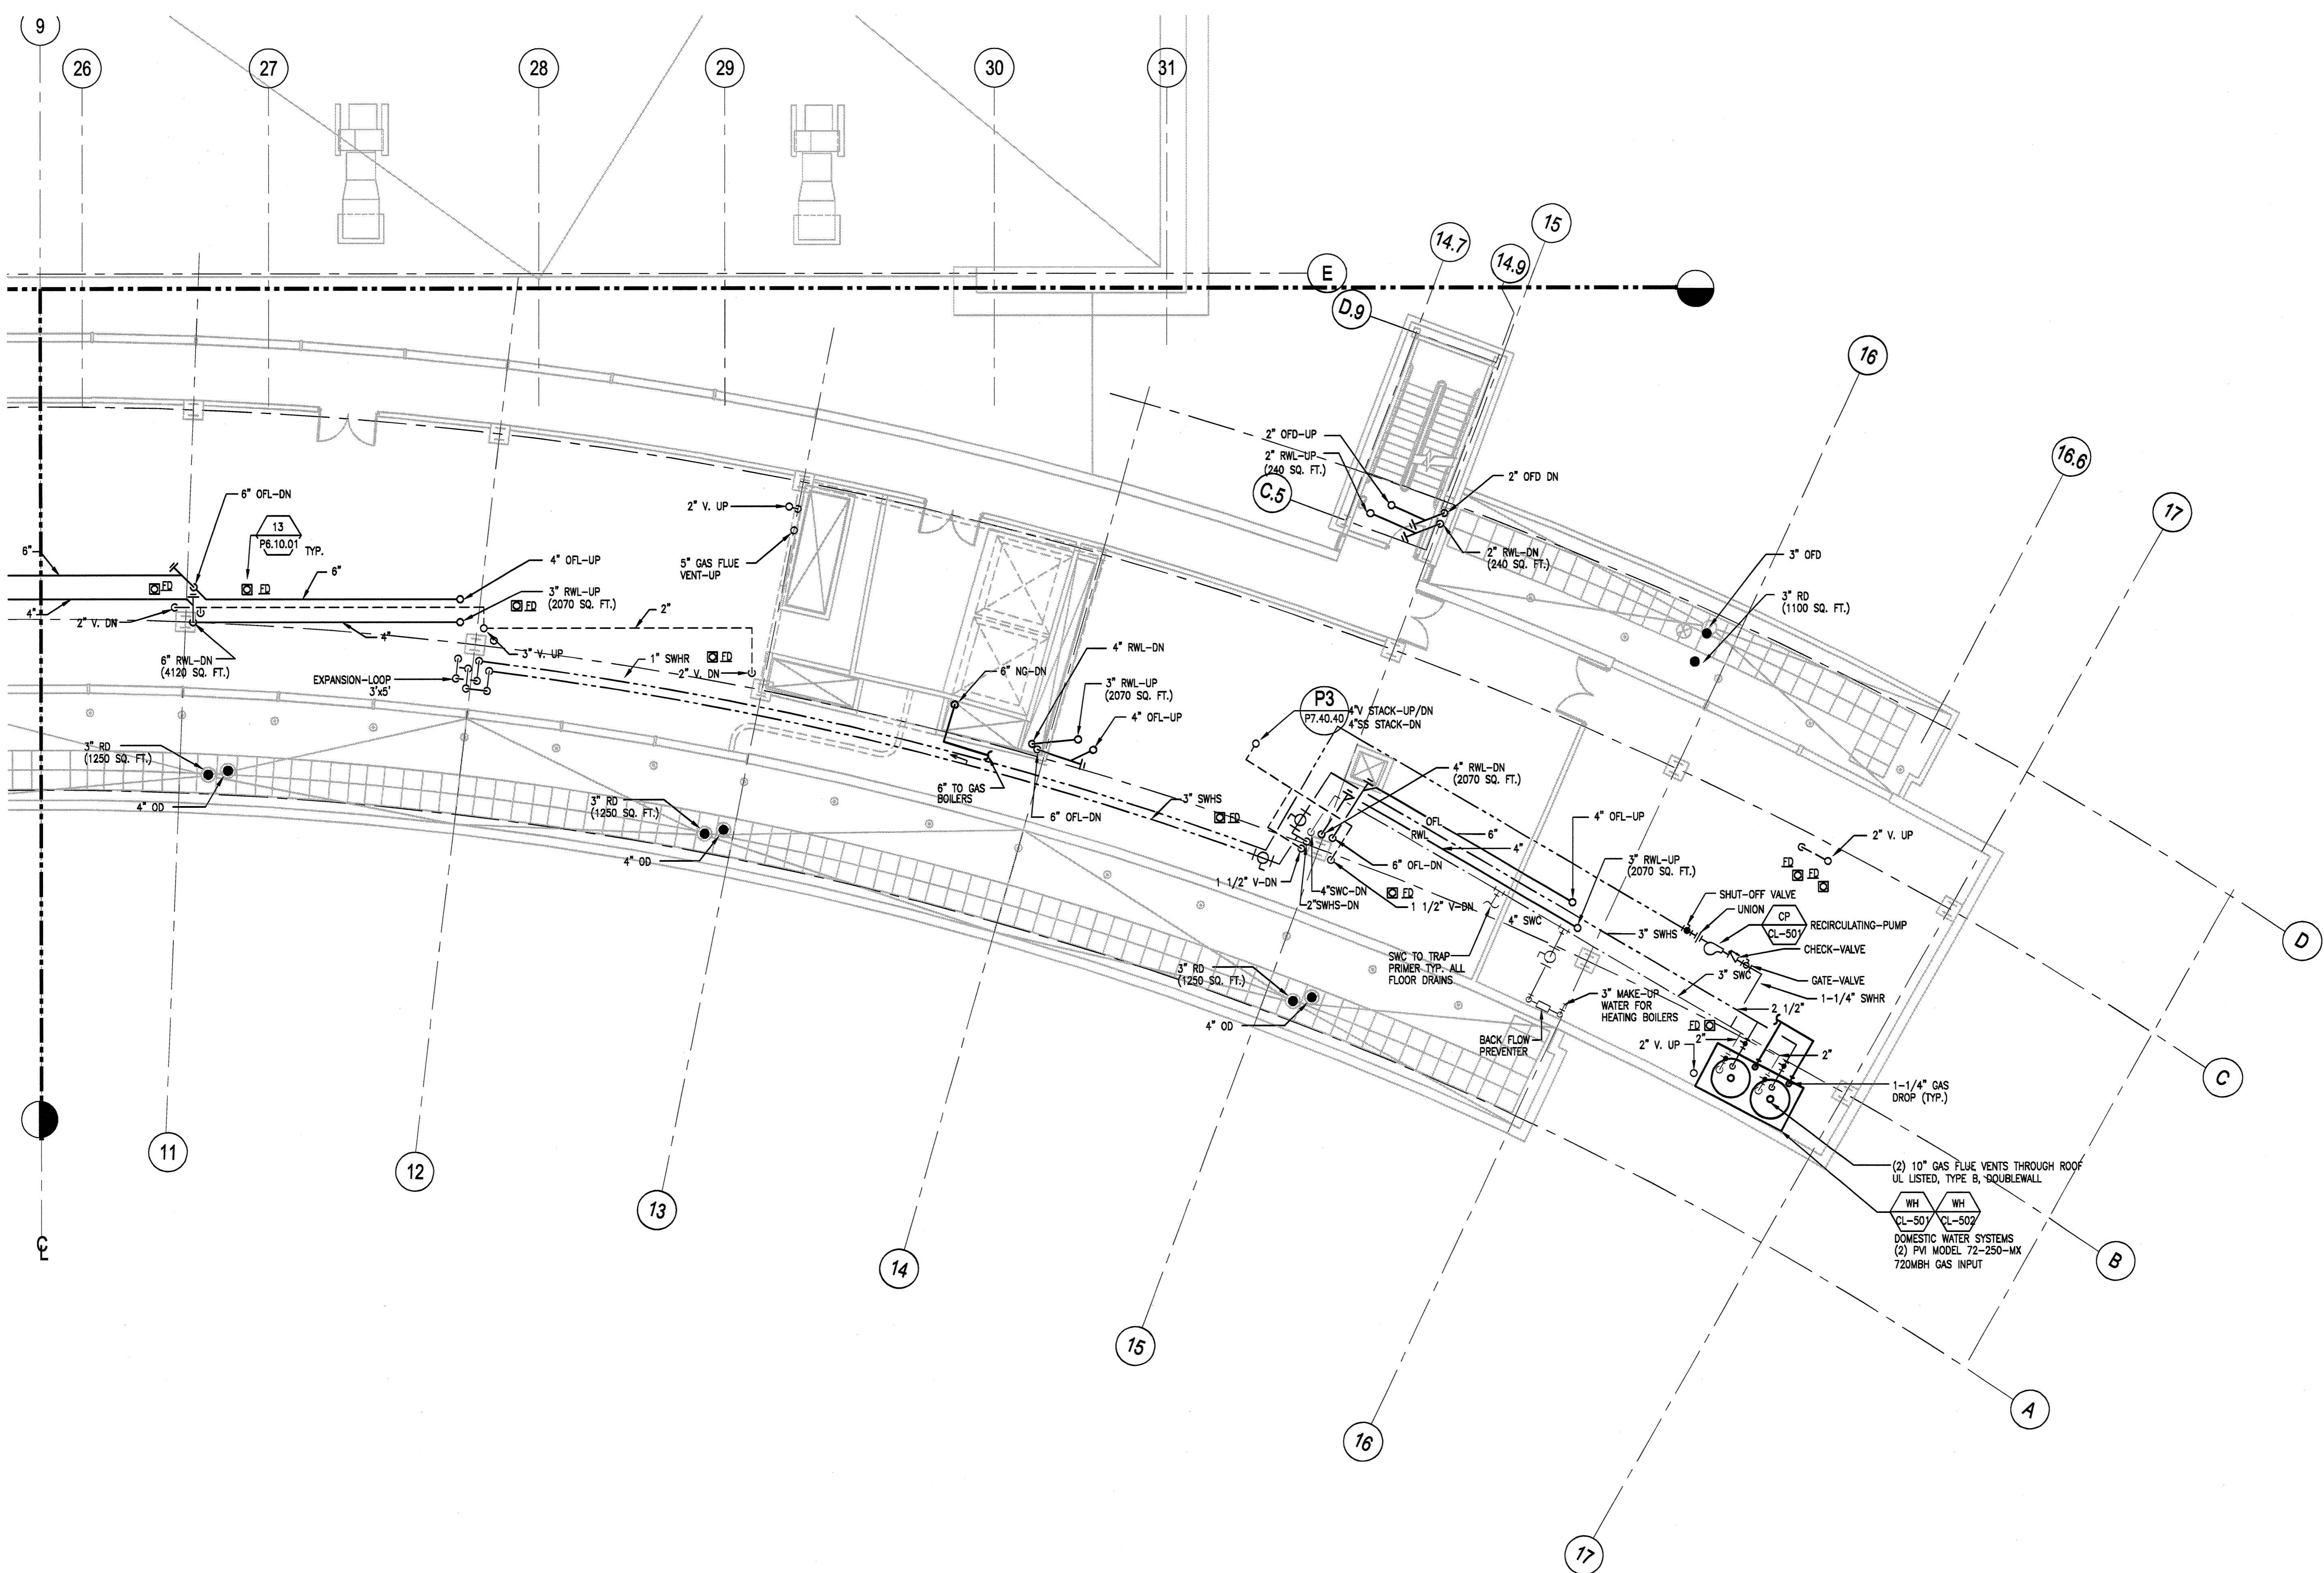

108031400-P8E-8600-A043

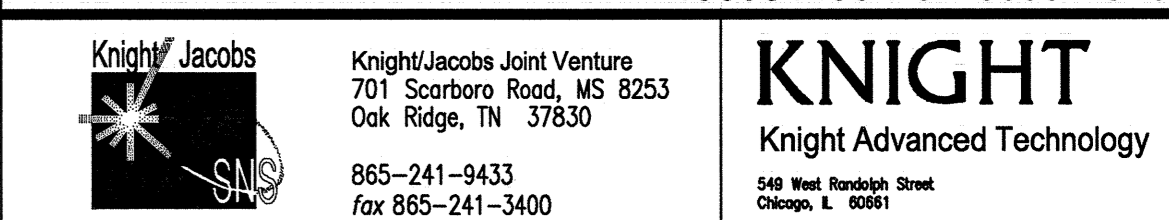

Ridge National Laboratory  
for the DEPARTMENT OF ENERGY under  
ERMENT contract DE-AC05-00OR22725



U.S. DEPARTMENT OF ENERGY  
DOE

Oak Ridge National Laboratory  
managed for the DEPARTMENT OF ENERGY under  
U.S. GOVERNMENT contract DE-AC05-00OR22725

PROJECT NAME:  
SPALLATION NEUTRON SOURCE  
CENTRAL LAB AND OFFICE BUILDING  
PLUMBING FLOOR PLAN  
LEVEL 5, SECTOR 62

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	P	X	X	8	8600		1	1	P	U
51	52	53	WBS				P2.05.62			REV
NC	NA		1.8.3.14							1


NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

SECTION AND DETAIL KEY

THIS DOCUMENT  
CONTROLLED BY  
CHANGE CONTROL  
SYSTEM 4  
ENGINEERING  
PROCEDURE SNS-ENG-

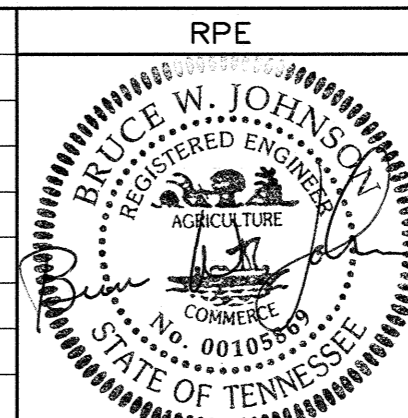[illegible]

DSN	M. WITHROW	05/15/01
DRW	T. WHITE JR.	05/15/01
CHK	B. JOHNSON	05/15/01
DEPT		
PE	C.L. GARREN	9/6/01
PU	J. STELLERN	08/21/01

REQ		
UTB	J.R. LAWSON	09/25/01
APPROVALS		